

National Institute of Design Assam
Tocklai, Rajabari, Jorhat-785014
Assam

NIDJ/2026-27/Estate/Electrical/ 382

Dated:10-08-2026


CORRIGENDUM - 1

In partial modification to Tender Notice No. **NIDJ/2026-27/ESTATE/ELECTRICAL/NIT/369**, The amended price bid and site layout is as below:

Sl. No	DSR 2025 E&M	Description	UOM	Qty	Rate	Total
1	27.7	Providing, laying, testing & commissioning of 'C' class heavy duty MS pipe conforming to IS 1239/Class -II of IS: 3589 including Welding, fittings like elbows, tees, flanges, tapers, nuts bolts, gaskets etc. and fixing the pipe on the wall/ceiling with suitable clamp/support frame and painting with two or more coats of synthetic enamel paint of required shade complete as required:				
1.1	27.7.1	25 mm dia	Meter	20		
1.2	27.7.2	32 mm dia	Meter	20		
1.3	27.7.6	80 mm dia	Meter	93		
1.4	27.7.7	100 mm dia	Meter	295		
1.5	27.7.8	150 mm dia	Meter	126		
2	27.10	Supplying and fixing Single headed external yard hydrant valve with 1 No. 63 mm dia instantaneous FM Gunmetal/Stainless Steel coupling and cast-iron wheel, ISI marked, conforming to IS 5290 (type A) with blank Gunmetal/Stainless Steel cap and chain as required :				
2.1	27.10.1	Single headed Gunmetal	Each	10		
3	27.12	Supplying, fixing, testing & commissioning of double flanged sluice valve of rating PN 1.6 with non rising spindle, bronze/gun metal seat, ISI marked complete with nuts, bolts, washers, gaskets and conforming to IS 780 of following sizes as required :				
3.1	27.12.5	100mm dia	Each	2		


4	27.13	Supplying and fixing orifice plate made out of 6 mm thick stainless steel (Grade 304) with orifice of required size to be fitted between flange & landing valve of external and internal hydrants to reduce pressure at the outlet to the level of 3.5 kg/cm ² complete as required.	Each	10		
5	27.19	Supplying and fixing of fire brigade connection of cast iron body with gun metal male instantaneous inlet couplings complete with cap and chain as reqd. for suitable dia MS pipe connection conforming to IS 904 as required:				
5.1	27.19.2	4 way - 150 mm dia M.S. Pipe	Each	3		
6	27.21	Providing, fixing, testing & commissioning of 15mm dia quartzoid bulb type sprinklers of rating 68 0C with required accessories :				
6.1	27.21.3	Horizontal side wall sprinkler	Each	40		
7	27.22	Providing & fixing of pressure switch in M.S. pipe line including connection etc. as required.	Each	5		
8	27.25	Supplying, installation, testing & commissioning of sprinkler flexible pipe (UL Listed) of stainless steel complete with 15 NPT on reducer thread with maximum working pressure of 175 PSI test pressure of 875 PSI (Burst) with branch line (Inlet) 25mm NPT male thread to sprinkler head (Outlet) 15mm NPT female thread with reducer, nipple, 2 side brackets, center bracket, stockbar of following sizes complete as required.				
	27.25.1	700mm	Each	40		
				Total		
				GST Rate		
				GST Amount		
				Grand Total		

Sd/-
Chief Administrative Officer
National Institute of Design Assam
Jorhat - Assam

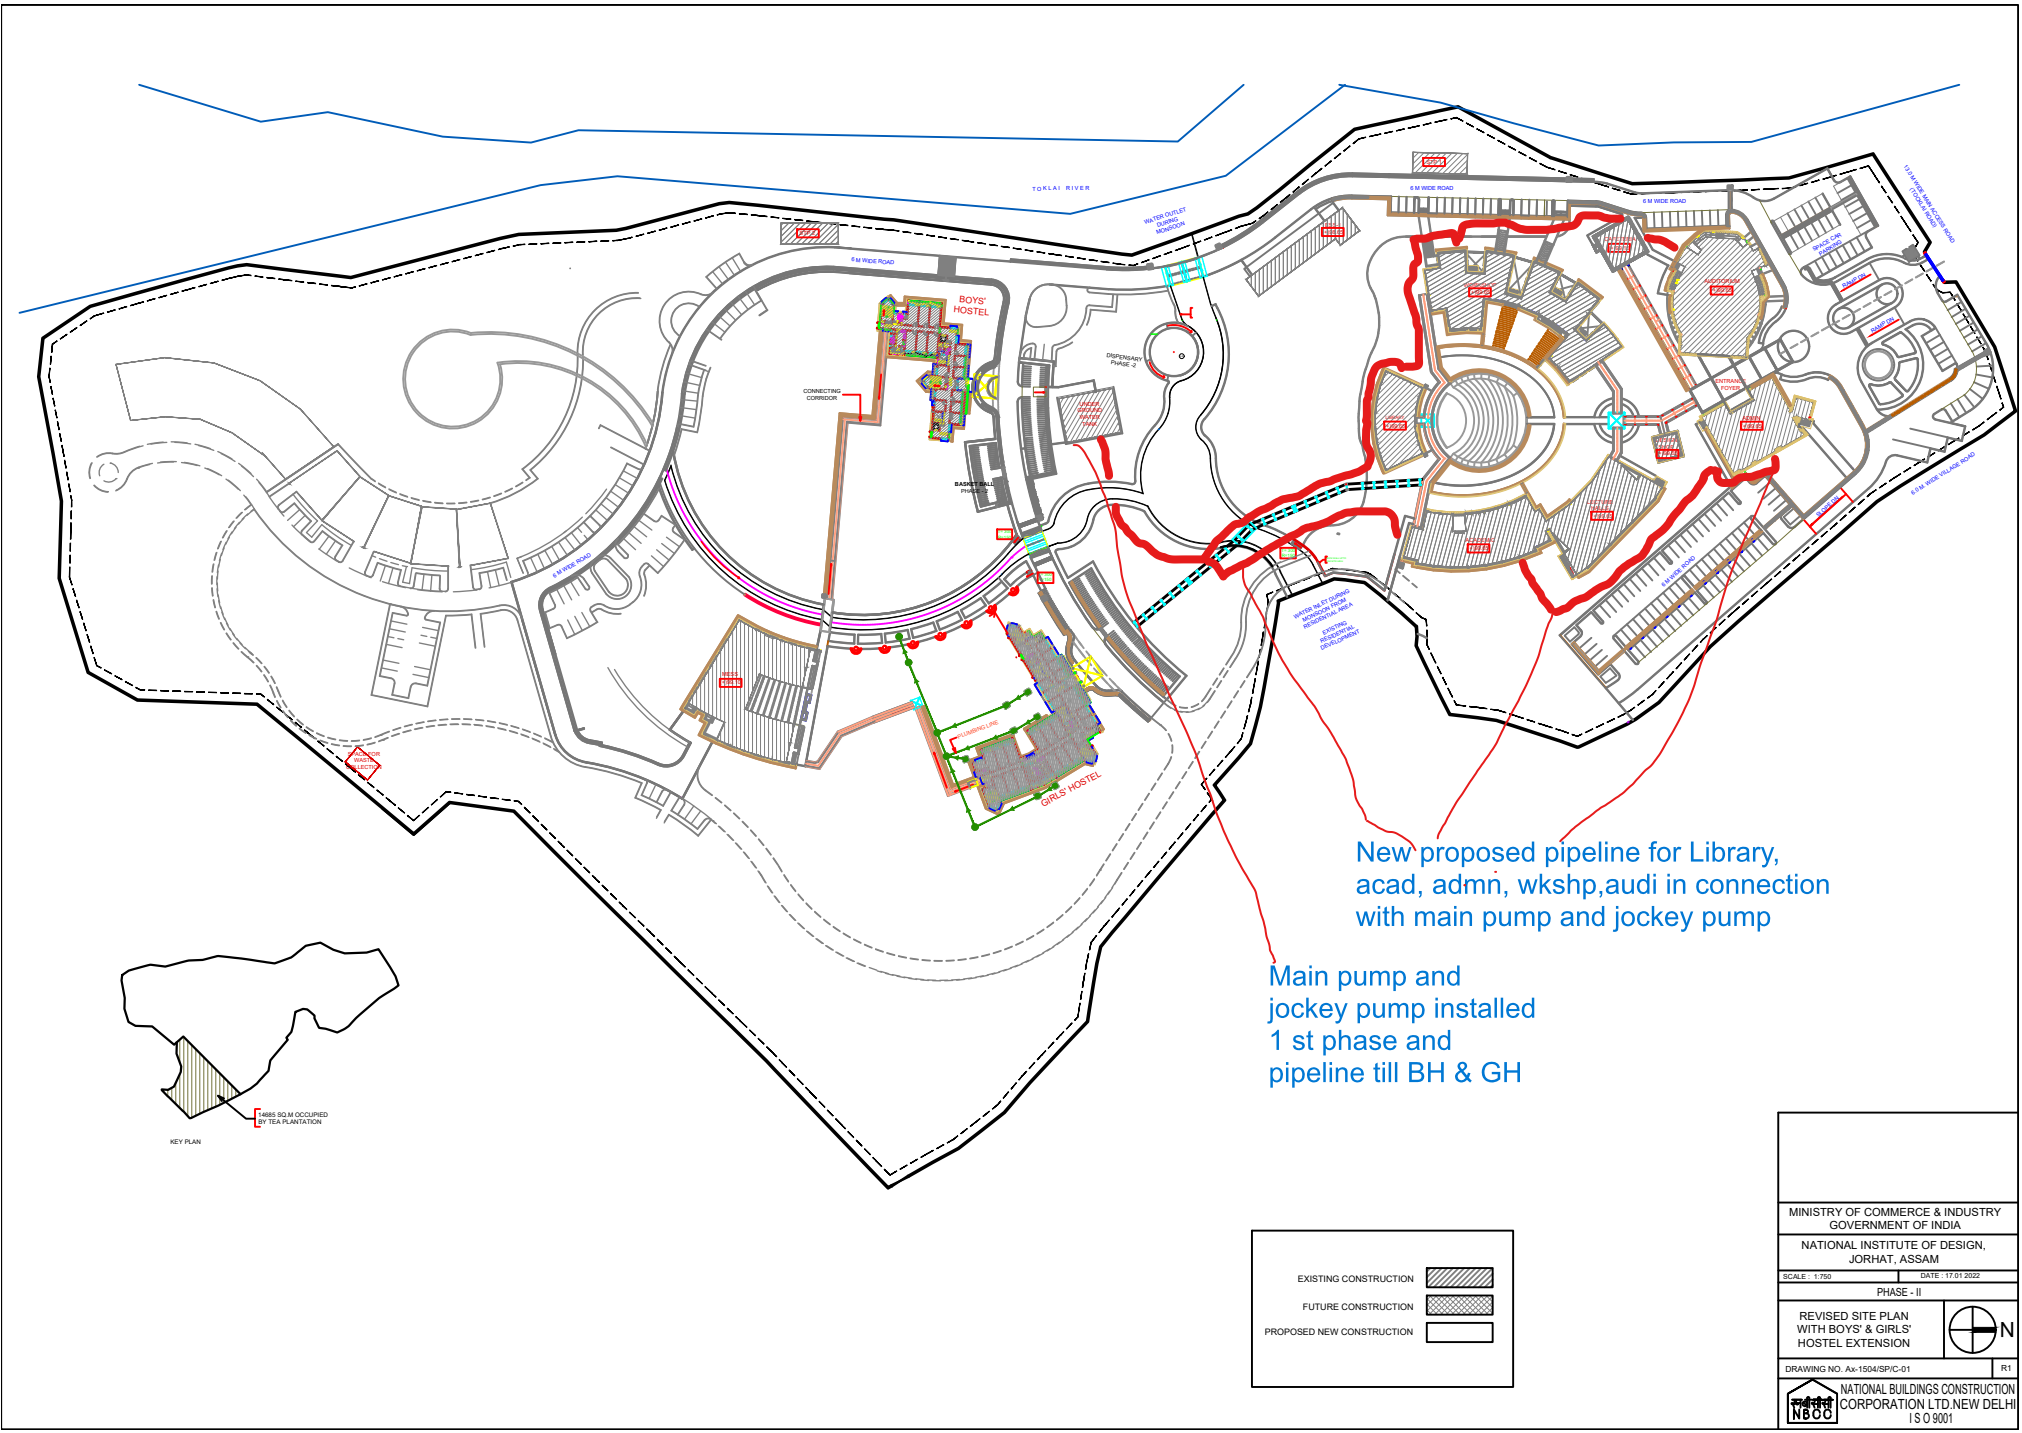

New proposed pipeline for Library, acad, admn, wkshp, audi in connection with main pump and jockey pump

Main pump and jockey pump installed 1 st phase and pipeline till BH & GH



EXISTING CONSTRUCTION	
FUTURE CONSTRUCTION	
PROPOSED NEW CONSTRUCTION	

MINISTRY OF COMMERCE & INDUSTRY GOVERNMENT OF INDIA	
NATIONAL INSTITUTE OF DESIGN, JORHAT, ASSAM	
SCALE : 1/750	DATE : 17.01.2022
PHASE - II	
REVISED SITE PLAN WITH BOYS' & GIRLS' HOSTEL EXTENSION	
DRAWING NO. AN/1504/SPIC-01	1/1
NATIONAL BUILDINGS CONSTRUCTION CORPORATION LTD. NEW DELHI IS O 9001	